

YELLOWHEAD RV PARK AND CAMPGROUND



ANNUAL REPORT WATER SYSTEM 2025



Yellowhead RV Park & Campground Water System

Connections:	<i>47 Connections</i>
Maximum Population:	<i>300</i>
Total Length of distribution Mains:	<i>1 Kilometer</i>
Average Population served in 24 hours:	<i>150</i>
Source of Water:	<i>Swift Creek</i> <i>Sand Gravel from creek to well</i>
Global Position:	<i>Latitude: N 52.835946</i> <i>Longitude: W 119.284174</i>

TREATMENT PLANT:


Enclosed secured building housing water system.

Ultraviolet and Chlorination Treatment.

Note to Immunocompromised Individuals:

- No water supply is 100 per cent safe, and sudden water quality failures can take hours even days to identify and communicate out to the entire community. People who have HIV/AIDs, are undergoing chemotherapy or have compromised immune systems are advised to consider boiling their water or installing an in-home drinking water treatment device capable of reducing their risk of illness.
- *HealthLink BC file Number 56*
- <https://www.healthlinkbc.ca/healthlinkbc-files/preventing-water-borne-infection>

1ST STAGE UV TREATMENT

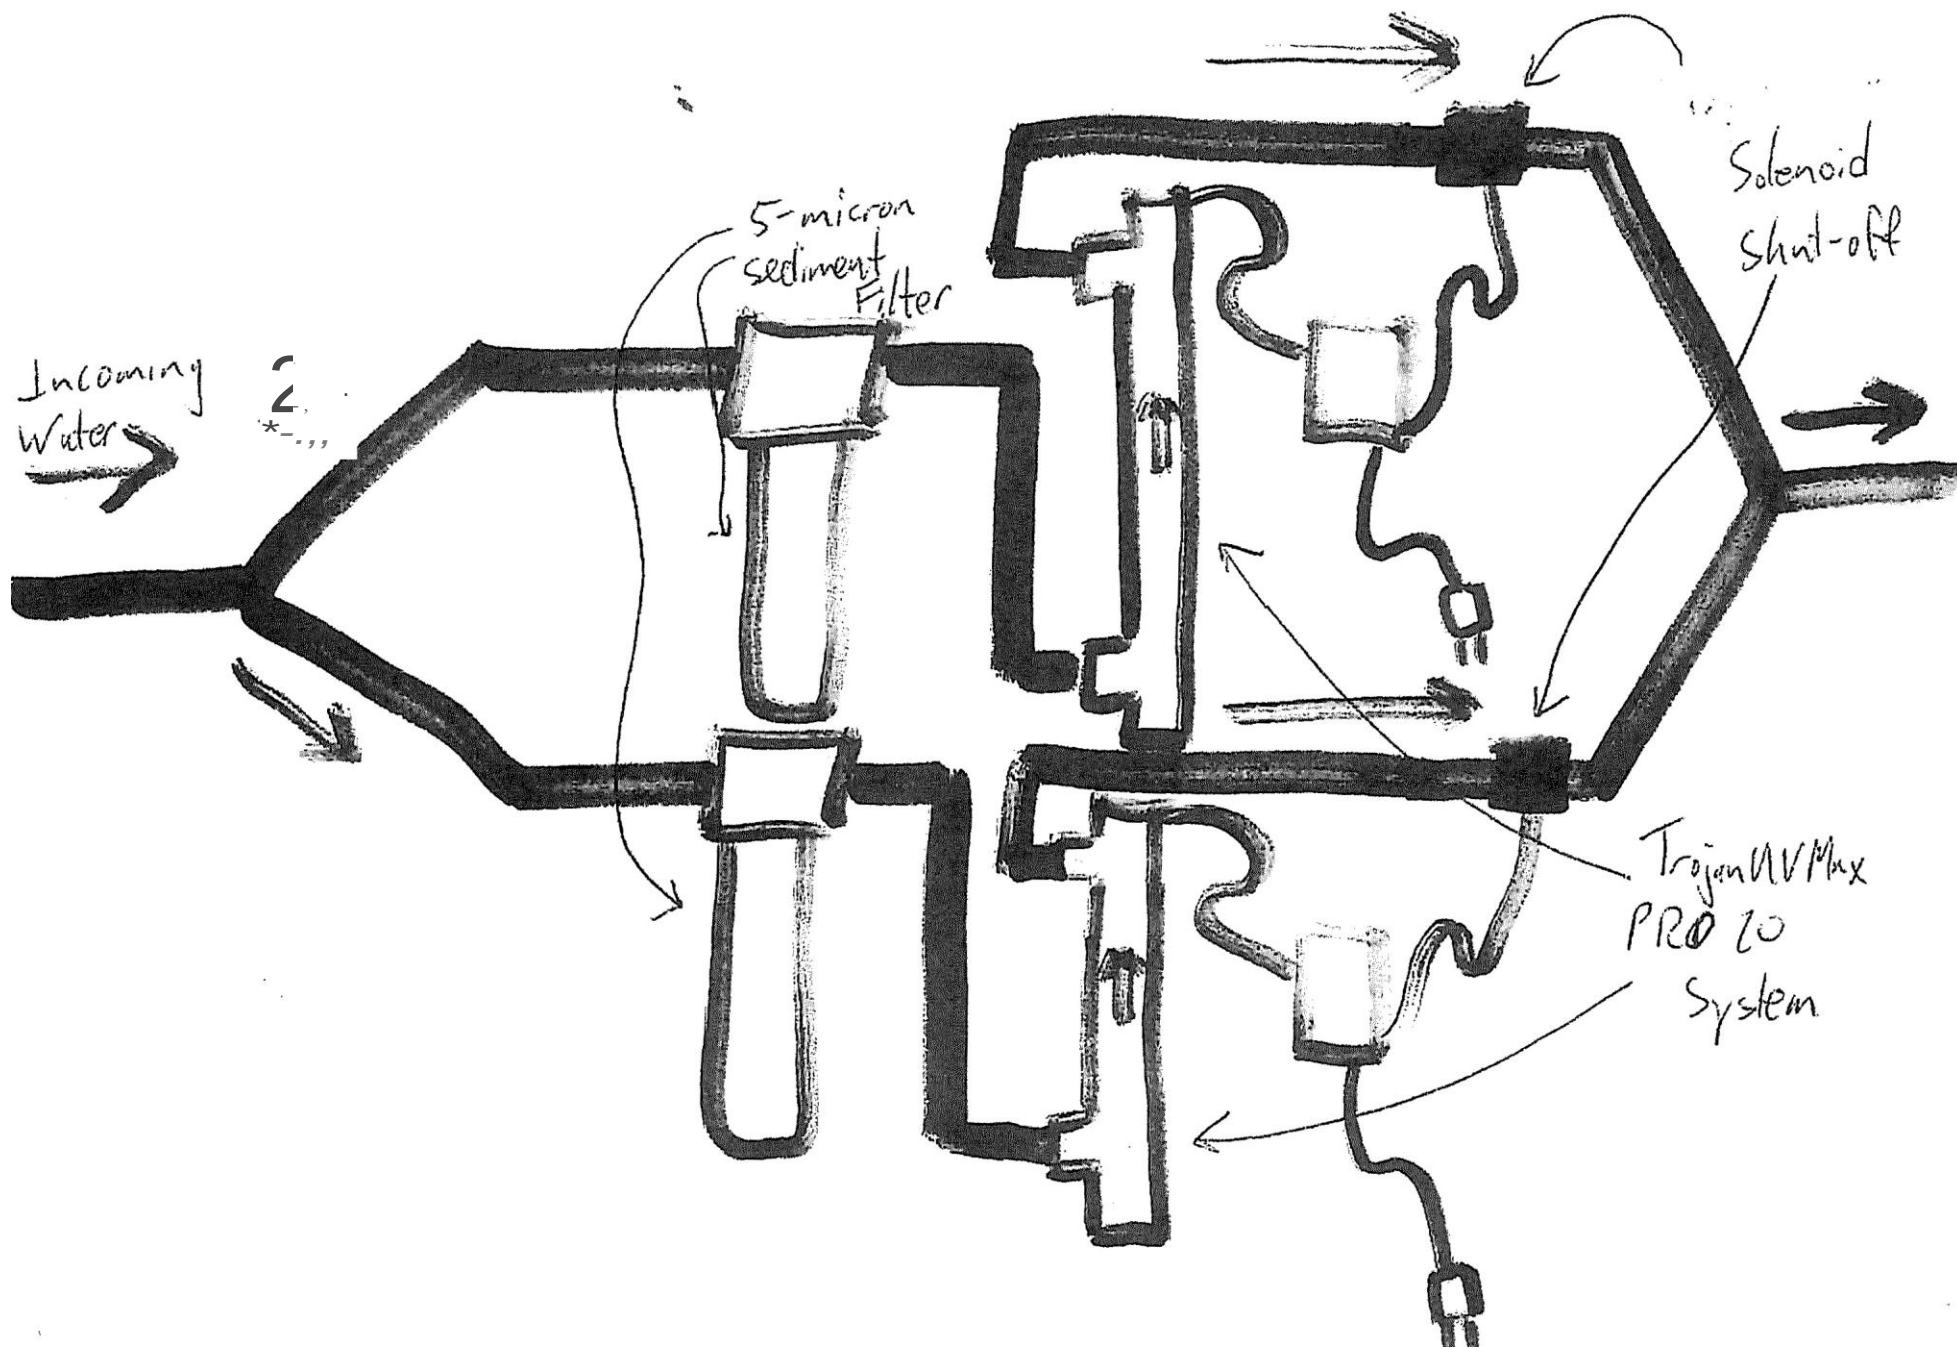

WATER QUALITY DATA COLLECTION:

Chemical Sampling:

Total and Free Chlorine samples taken daily when campground open for the season

Season runs from mid-May to September.

Bacteriological Sampling: sent to **Northern Health Labs**

Date	Location	Total Coliform	Fecal Coliform
Sep 17, 2025	Site 44 Wash	LT1	LT1
	House	LT1	LT1
Aug 26, 2025	Site 44 Wash	LT1	LT1
	House	LT1	LT1
Jul 29, 2025	Site 44 Wash	LT1	LT1
	House	LT1	LT1
Jun 25, 2025	Site 44 Wash	LT1	LT1
	House	LT1	LT1
May 21, 2025	Site 44 Wash	LT1	LT1
	House	LT1	LT1